



Exhibitor

Hall / Stand no.

VAT no.

Contact

Street / P.O. Box

E-mail

Country / Town / Postcode

Tel. with area code and ext.

Fax with area code and ext.

All electrical connections comprise the following standard features:

- Electrical compliance inspection carried out by an independent expert
- Refrigerator socket (continuous power supply)
- First point of earthing of stand
- Residual current protective device (30 mA)

– The price includes the cost of the power consumed

- over the entire period of the trade fair for connections up to and incl. 3 x 25 A
- as from 3 x 32 A, three Schuko safety sockets are included; the actual consumption is logged via a meter and charged at EUR 0.30/kWh.

Please mark	Item no.	Main electrical connection	EUR/unit
	20500	AC connection, fusing with 1 x 16 ampere incl. 1 x Schuko safety socket (230 V, 50 Hz, max. 3 kW)	139.00
	20507	3-phase connection, fusing with 3 x 16 ampere incl. 3 Schuko safety sockets (230/400 V, 50 Hz, max. 9 kW)	388.00
	20509	3-phase connection, fusing with 3 x 16 ampere incl. CEE adapter (3 P, N, PE) 16 A (230/400 V, 50 Hz, max. 9 kW)	388.00
	20513	3-phase connection, fusing with 3 x 25 ampere incl. 3 Schuko safety sockets (230/400 V, 50 Hz, max. 15 kW)	494.00
	20516	3-phase connection, fusing with 3 x 25 ampere incl. CEE adapter (3 P, N, PE) 32 A (230/400 V, 50 Hz, max. 15 kW)	494.00
	20584	3-phase connection, fusing with 3 x 32 ampere incl. CEE adapter (3 P, N, PE) 32 A (230/400 V, 50 Hz, max. 20 kW)	616.80
	20596	3-phase connection, fusing with 3 x 63 ampere incl. CEE adapter (3 P, N, PE) 63 A (230/400 V, 50 Hz, max. 40 kW)	875.50

Please mark	Item no.	Main electrical connection	EUR/unit
	20632	3-phase connection, fusing with 3 x 32 ampere (230/400 V, 50 Hz, max. 20 kW)	566.00
	20633	3-phase connection, fusing with 3 x 50 ampere (230/400 V, 50 Hz, max. 32,5 kW)	690.00
	20634	3-phase connection, fusing with 3 x 63 ampere (230/400 V, 50 Hz, max. 40 kW)	814.00
	20635	3-phase connection, fusing with 3 x 80 ampere (230/400 V, 50 Hz, max. 50 kW)	935.00
	20636	3-phase connection, fusing with 3 x 100 ampere (230/400 V, 50 Hz, max. 65 kW)	1,120.00
	20637	3-phase connection, fusing with 3 x 125 ampere (230/400 V, 50 Hz, max. 80 kW)	1,364.00
	20638	3-phase connection, fusing with 3 x 160 ampere (230/400 V, 50 Hz, max. 120 kW)	1,868.00

Any extras required (Schuko safety circuits, CEE circuits, connecting and disconnecting, etc.) must be ordered separately via form 3.2. If you require connections with higher ratings, kindly contact the Department Events MOC.

**Important to note: order cannot be processed without a stand layout plan!**

**Please note:**

**A surcharge of 20% will be raised for any orders/plans submitted later than ten calendar days before the start of the event.**

The exhibitor is obliged to deactivate the entire electrical system on a daily basis after the fair closes using the master switch incorporated into the main connection.

**All liability for damage resulting from non-compliance with this provision is to be borne by the exhibitor or stand holder, as well as any additional costs.**

**By way of my signature, I herewith recognize the terms and conditions of connection and supply.**

Place / date

Company stamp and legally binding signature of exhibitor

## ■ Main electrical connection for outdoor exhibition area

Please mark	Item no.	Main electrical connection	EUR/unit
	20643	<b>Connecting pillar, 3-phase connection, fusing with 1 x 16 ampere incl. 1 x Schuko safety socket (230 V, 50 Hz, max. 3 kW)</b>	207.00
	20644	<b>Connecting pillar, 3-phase connection, fusing with 3 x 16 ampere incl. CEE adapter (3 P, N, PE) 16 A (230/400 V, 50 Hz, max. 9 kW)</b>	514.00
	20645	<b>Connecting pillar, 3-phase connection, fusing with 3 x 32 ampere incl. CEE adapter (3 P, N, PE) 32 A (230/400 V, 50 Hz, max. 20 kW) plus consumption</b>	670.00

The connecting pillar is the point of transfer. Any extension cables required will be charged for on the basis of the actual costs incurred.

Hall / stand no.


Exhibitor

Place / date

■ **Electrical connection plan**

Please indicate the location of your stand by showing adjacent stands, aisles or hall entrances or by entering a north-pointing arrow on the layout plan! Please also specify the positioning of your power connection. Sketch must include to-scale dimensions.

■ **Important to note:** order cannot be processed without a stand layout plan!

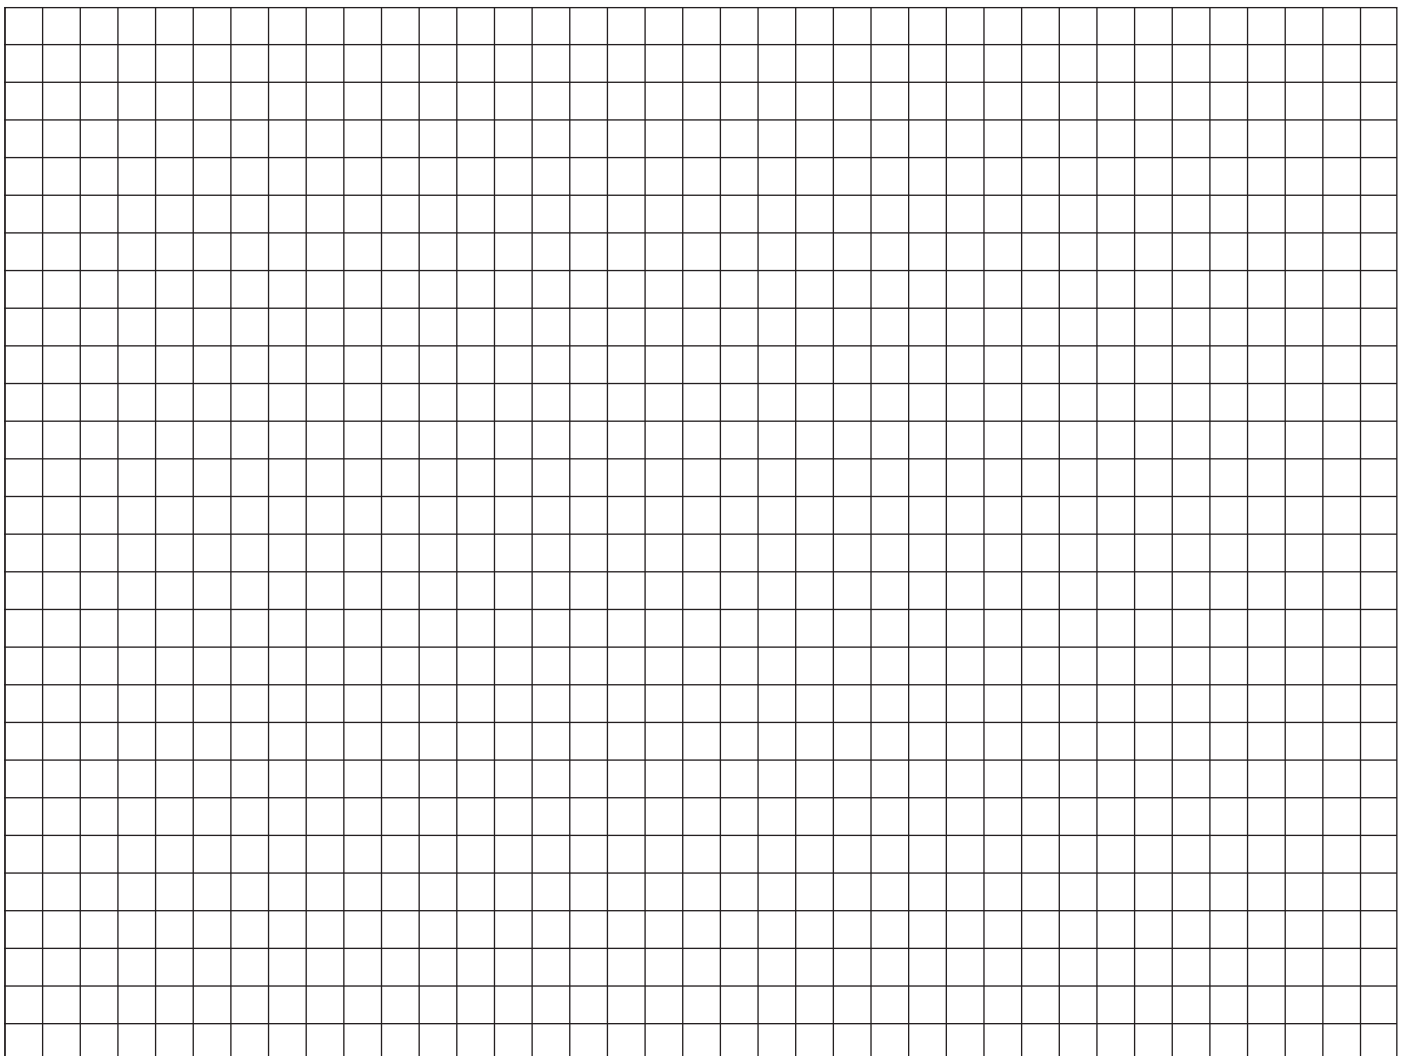

\_\_\_\_\_  
Hall / stand no.

\_\_\_\_\_  
Exhibitor

\_\_\_\_\_  
Place / date